

KARNES ELECTRIC COOPERATIVE, INC.

Main Office (830)780-3952

Pleasanton Office (830)569-5538


Date: 02-04-11

METER ON HOUSE OR BUILDING ATTACHMENT ON EAVE SERVICE NOT TO EXCEED 300 VOLTS

COOPERATIVE FURNISHED, OWNED AND INSTALLED

- A. Meter
- B. K-10
- C. Conduit
- D. Meter Base
- E. Straps
- F. Wire
- G. Ground Rod and Ground Wire
- H. 1/2" Conduit

****** EVERYTHING IS TO BE INSTALLED ON HOUSE BY ELECTRICIAN.

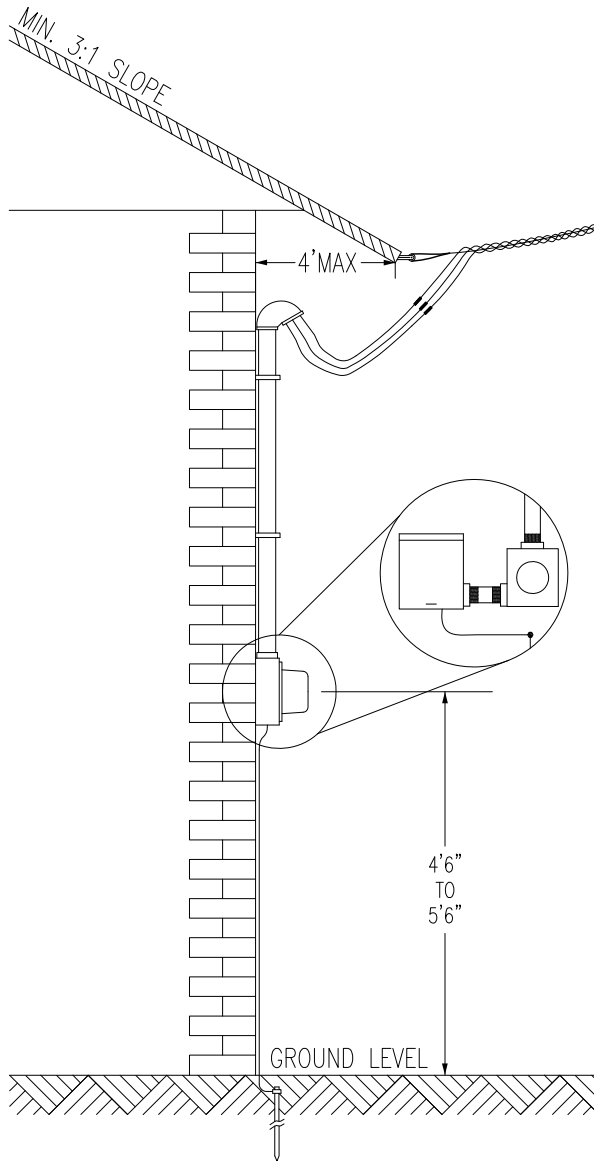

MEMBER FURNISHED

- A. Main Disconnect with Main Breaker.
- B. Metallic Nipple, Hub and Locknuts.
- C. Bell Bushing Wire Protector in All Conduit Openings.
- D. Disconnect Shall Be Grounded to Ground Wire.

NOTE: 200 AMP SERVICE REQUIRES 2" CONDUIT & 3/0 COPPER WIRE.
125 AMP SERVICE REQUIRES 1 1/2" CONDUIT & 1/0 COPPER WIRE.